
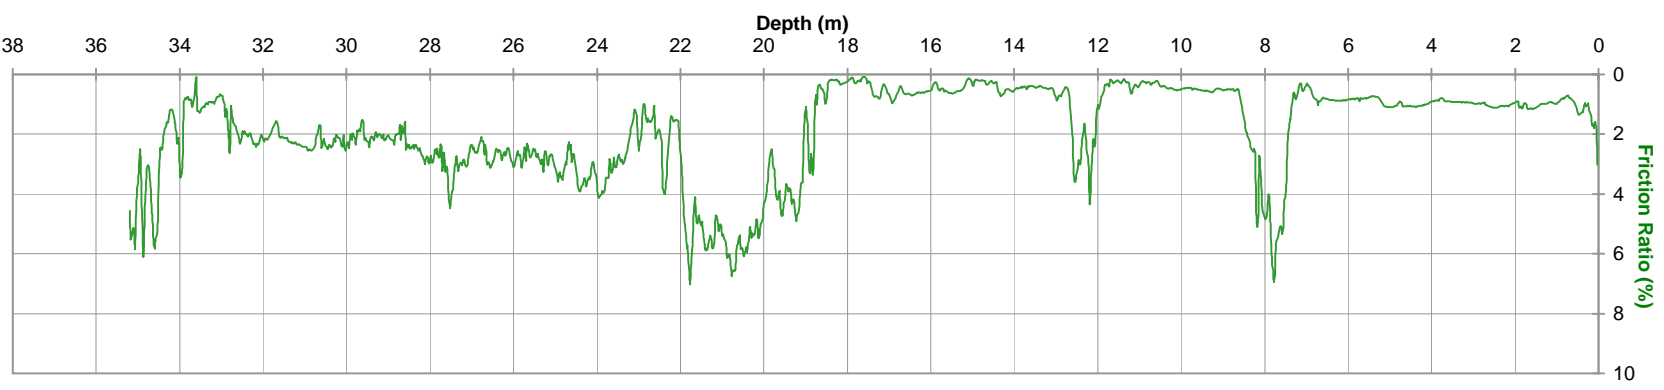
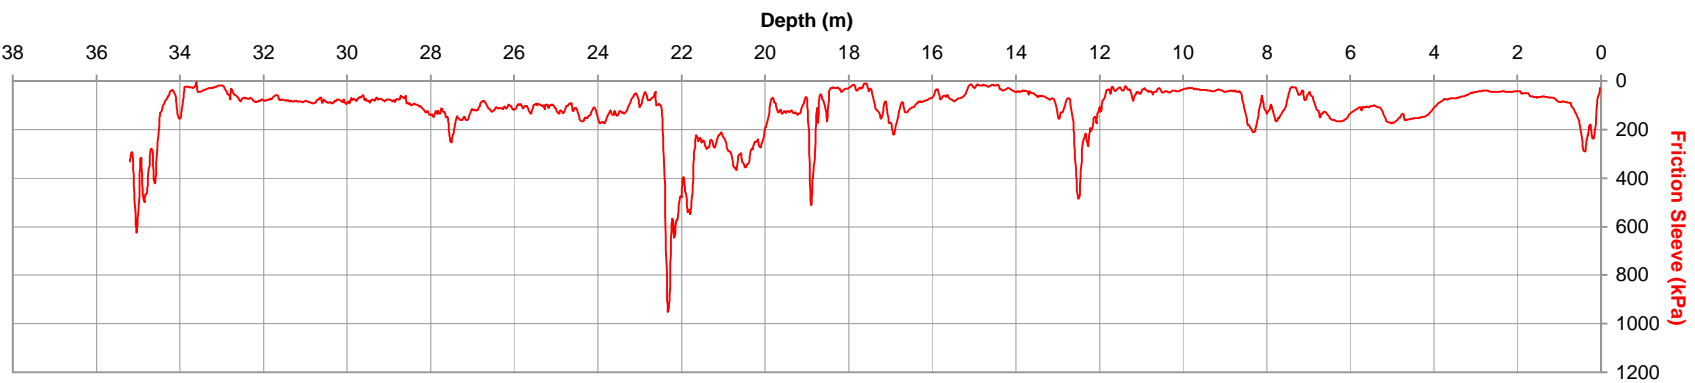


ELECTRIC FRICTION-CONE PENETROMETER

CLIENT:
PROJECT:
LOCATION:

Date:
Probe No.: P 3A S
Job Number:
Co-ordinates:

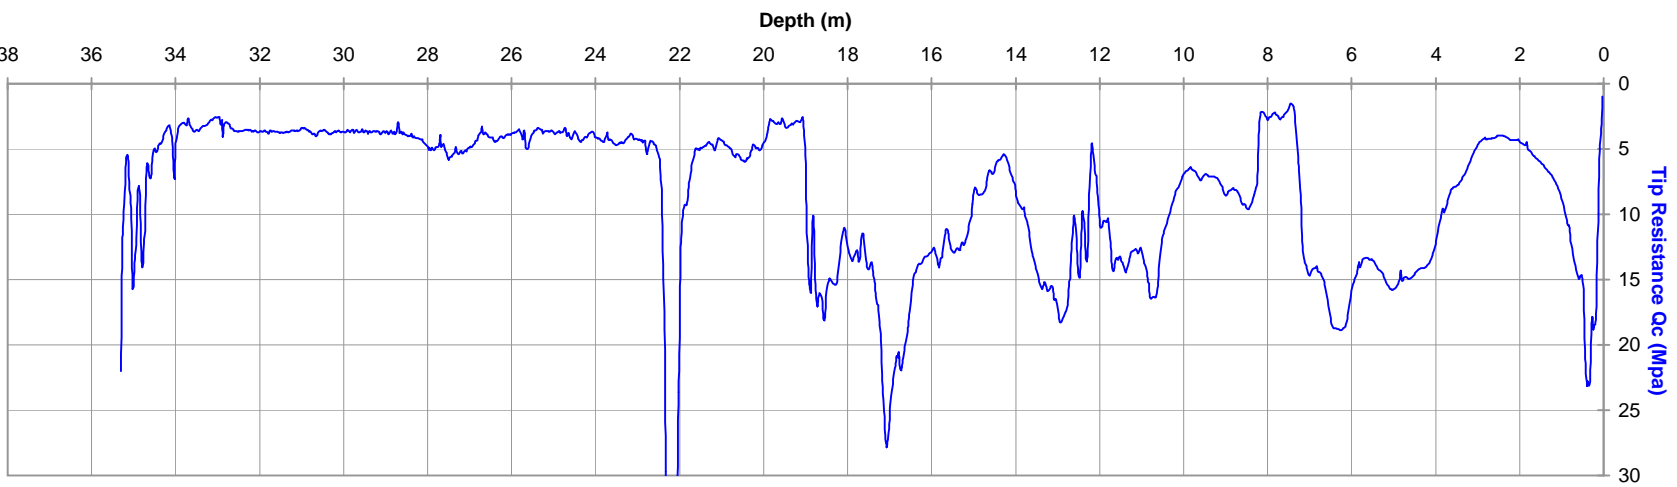

Water (m): Dytod,0
Refusal: 22MPa+R.F.

Tested in accordance with AS 1289.6.5.1 - 1999
and IRTP 2001 for friction reducer

File:

32mm standpipe installed(m):

Cone I.D. : EC823TC

25 tonne truck mounted CPT rig